

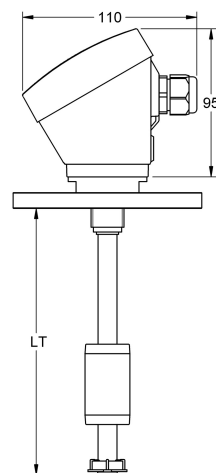


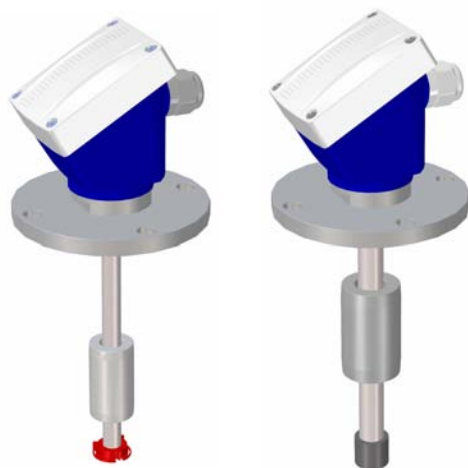

## IMN BB PP

### MAGNETIC LEVEL SWITCH



General	Operating principle	The IMN level magnetic sensors are based on the action of a reed switch located inside the tube, which is activated by a magnet housed inside the float and moves due to the thrust of the liquid.	
	Application	· For the detection of one or more points in liquid level. · Used in maneuvers for filling, emptying, overflow alarm, etc.	
	Manufacturing	Are customized to suit the installation conditions.	
Housing	Electrical connection	Connection housing. PBT. 64x95x110 mm	
	Protection	IP67	
	Temperature (T <sub>a</sub> )	-20..+80 °C	
	Cable gland	M20 x 1,5 mm. PA. IP68	
	Ø Cable hose (mm)	6..12 mm	
Body	Guide tube and stops	100..3500 mm Ø16 mm (PP) <b>FCPP05M18</b> (PP)	
	Temperature	-10..+60 °C	
	Mounting position	Vertical, ±15°	
Process connection	Flange	<b>BR120</b>	
	Material	PP	
	n x t (mm)	4x12	
	Ø d (mm)	100	
	D (mm)	120	
	Thickness (LCP) (mm)	10	
Floats	Model	<b>FCPP05M18</b>	
	Material	PP	
	Dimension (mm)	Ø 38x60	
	Pressure (kg/cm²)	3	
	Density (g/cm³)	e > 0,5	
	FS / FH (mm)	30 / 30	
Contacts	Nr. of contacts	1..5	
	Class	NO: 120 WVA / 250 VAC-3A NC-NO/NC: 60 WVA / 230 VAC-1A	
	Distance between them	> 40 mm	
Protection	Standard	Normal execution without inner filling. Applicable to most applications.	
	Protected	Anti-condensation effect. In installations where there are large temperature differentials.	
	Insulated	Filled with epoxy resin. Establishing a higher degree of tightness.	

## How to determine the sensor settings

Determine the total length according to the characteristics of the shell and the liquid level to be controlled.

According to the maneuver you wish to perform, determine the amount, location and type of contacts.  
Use the table below to define these characteristics.

**Contacts:** To set the type of contact (NO, NC, NONC) should be without the presence of the float. For example, if you want the lower end of the sensor contact opens when the tank runs out of fluid, seek an NC contact for the position.


**Direction of action** (↑ ↓): Set the direction of action of the float (the filling or emptying) allows more precise adjustment of the position of the contacts to the point of desired performance.

**Electrical connection:** If not otherwise specified explicitly, provide a common connection to all the contacts and an active connection for each of them, according to the diagram below.

**Additional floats:** The sensor comes equipped by default with a single float, the lower stop and if required, the upper stop. Can request as many additional floats as many contacts as necessary.

**Conditions of work:** Check that the conditions of pressure, temperature and density of your system match those offered by the model chosen. If you have questions regarding the behavior of materials in contact with the liquid you want to control, see chemical resistance chart on our website.

Apart from the possibilities listed here, there are others such as other floats, various electrical connections, etc. For any of these combinations refer to our document, "Connections and schema IMN" section in our website.

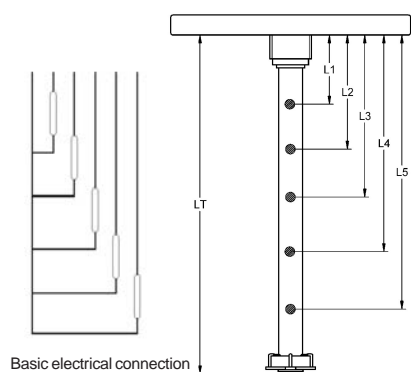

	mm	NO	NC	NONC	↑	↓	Stop
L1							
L2							
L3							
L4							
L5							
LT							

Use this document to define the data of sensor and attach it at the time of ordering.

Specify in mm. total length of the sensor.

Specify in mm. the position of each of the contacts used in your application. Place an "X" the type and direction of action of each contact.

In the case of using additional floats, mark an "X" between what contacts should be placed caps separators.

In the composition table references check boxes next to the selected features.

REFERENCE	VERSION	PROCESS	FLOAT	TOTAL LENGTH	Nr. CONTACTS	Nr. FLOATS
IMN BB PVC	<input type="checkbox"/> V1 Standard <input type="checkbox"/> V2 Protected <input type="checkbox"/> V3 Insulated	<input type="checkbox"/> P43 BR120	<input type="checkbox"/> F51 FCPP04M14 <input type="checkbox"/> F52 FCPP05M18	L 100..3500 mm	<input type="checkbox"/> C1 1 contact <input type="checkbox"/> C2 2 contacts <input type="checkbox"/> C3 3 contacts <input type="checkbox"/> C4 4 contacts <input type="checkbox"/> C5 5 contacts	<input type="checkbox"/> N1 1 float <input type="checkbox"/> N2 2 floats <input type="checkbox"/> N3 3 floats

To compose a reference, select an option from each of the columns. Example: IMN BB PVC V1 P43 F51 L500 C1 N1

Installations advise	Installation in areas with turbulence
<p>If the tank is metal walls, the probe will separate from them at least 100 mm.</p> <p>The maximum slope should be ±15°</p>	<p>Place the sensor as far as possible from areas of turbulence.</p> <p>Still pipe. Protects the race of the float of the turbulence.</p> <p>Separating wall or discouragement.</p> <p>PSIA, DSIA relay: Differential control of max. and min. by timing.</p>


## ELECTRICAL CONNECTION EXAMPLES

1 CONTACT							5 CONTACTS		
	CNX43	CNX44	CNX45	CNX84	CNX85				
2 CONTACTS									
	CNX46	CNX47	CNX48	CNX49	CNX50	CNX51	CNX52		
3 CONTACTS									
	CNX54	CNX55	CNX56	CNX57	CNX58	CNX59	CNX60	CNX61	
3 CONTACTS									
	CNX62	CNX63	CNX64	CNX65	CNX66	CNX67			
4 CONTACTS									
	CNX69	CNX70	CNX71	CNX72	CNX73	CNX74	CNX75	CNX76	
4 CONTACTS									
	CNX77	CNX78	CNX79	CNX80	CNX81	CNX82	CNX83		

More information regarding, in "Utilities / Tables" on our website ([www.disibeint.com](http://www.disibeint.com))


## 1 CONTACT

## CONTROL TO ONE MAXIMUM OR MINIMUM LEVEL

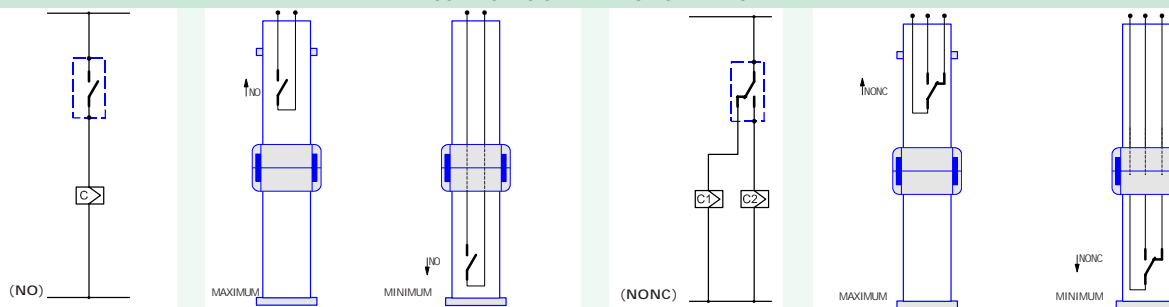


## 2 CONTACTS

## START-STOP WITH INTERLOCK

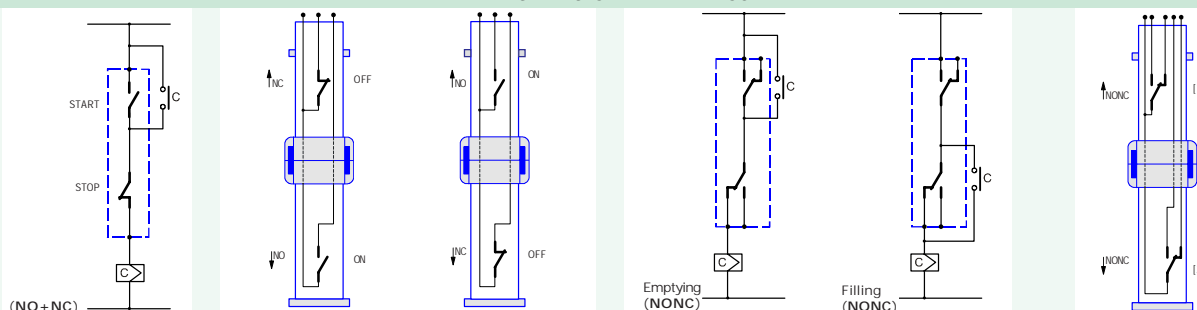


## 3 CONTACTS

## START-STOP EMPTYING + LEVEL MINIMUM ALARM

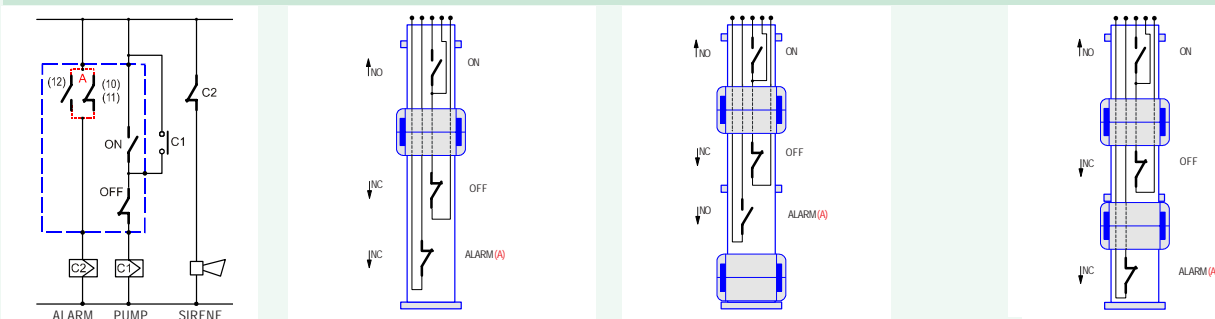


## 4 CONTACTS

## START-STOP FILLING + OVERFLOW ALARM

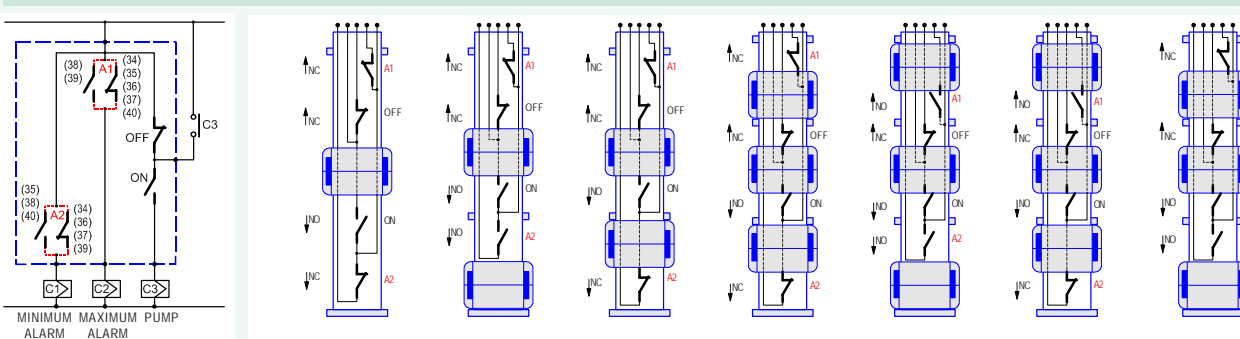

## 5 CONTACTS

## INDICATION or CONNECTION to PLC

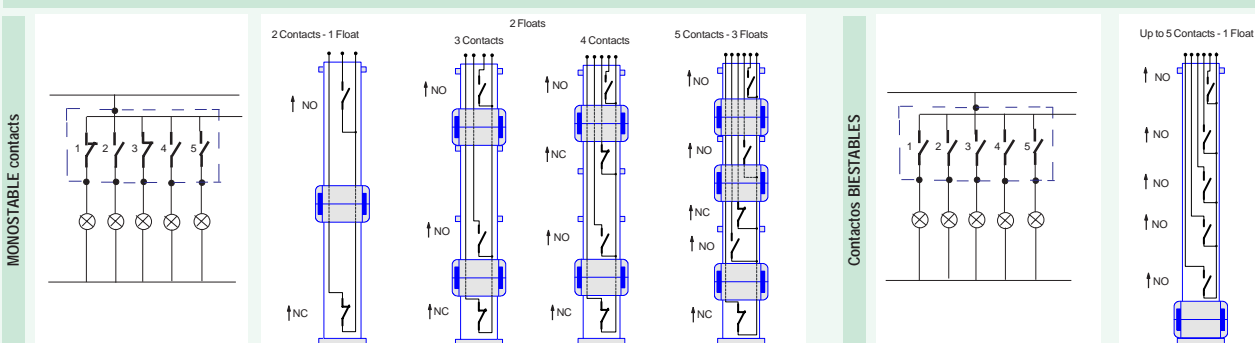

More related information in "Utilities / Tables" on our website ([www.disibeint.com](http://www.disibeint.com))